



Application for Water Permit

7800 Golden Valley Road, Golden Valley, MN 55427-4588
 Phone: (763) 593-8090 Fax: (763) 593-3997 TTY: (763) 593-3968

Date _____ Permit No. _____

Site Address _____	Suite # _____
---------------------------	---------------

Applicant: Owner _____ Contractor _____

Property Owner	Name _____ Phone: _____ Address _____ City _____ State _____ Zip _____
Contractor	Company _____ Address _____ City _____ State _____ Zip _____ Phone: _____ Fax: _____ E-mail _____ Contact Person: _____ Cell: _____ Contractor License # _____ Expiration Date _____

Sewer & Water (SW) Permit Type:	<input type="checkbox"/> 26 - Domestic Supply <input type="checkbox"/> 29 - Sprinkler Supply <input type="checkbox"/> 30 - Hydrant Supply
Work Type:	<input type="checkbox"/> 70 - New Service (Stub) <input type="checkbox"/> 71 - New Tap (Main) <input type="checkbox"/> 72 - Cut-off (Stub) <input type="checkbox"/> 73 - Cut-off (Main) <input type="checkbox"/> 81 - Remodel/Alter <input type="checkbox"/> 83 - Repair
Office Use Required Inspections	<input type="checkbox"/> 13 - Visual <input type="checkbox"/> 50 - Hydrostatic Test <input type="checkbox"/> 96 - Conductivity Test <input type="checkbox"/> 97 - Disinfecting Report <input type="checkbox"/> 98 - Other


Pipe Size _____ Pipe Length _____ Pipe Material _____ Fire Hydrant _____ P.I.V. _____

Estimated Value of Work \$ _____ Total Permit Fee \$ _____

Office Use Only	Fees
Water Service	\$ _____
Water Tap	\$ _____
Cut Off	\$ _____
Surcharge	\$ _____
Misc./Other	\$ _____
Total Fees	\$ _____

*** (Over) ***

NOTE:
 FORM GOOSENECK 6" ABOVE TAP TO ALLOW FOR SETTLEMENT.
 MAINTAIN A MINIMUM OF 7.5' OF COVER OVER SERVICE.
 ANY SERVICE LARGER THAN 1" REQUIRES 4" GATE VALVE WET
 TAPPED BLIND FLANGE REDUCER.

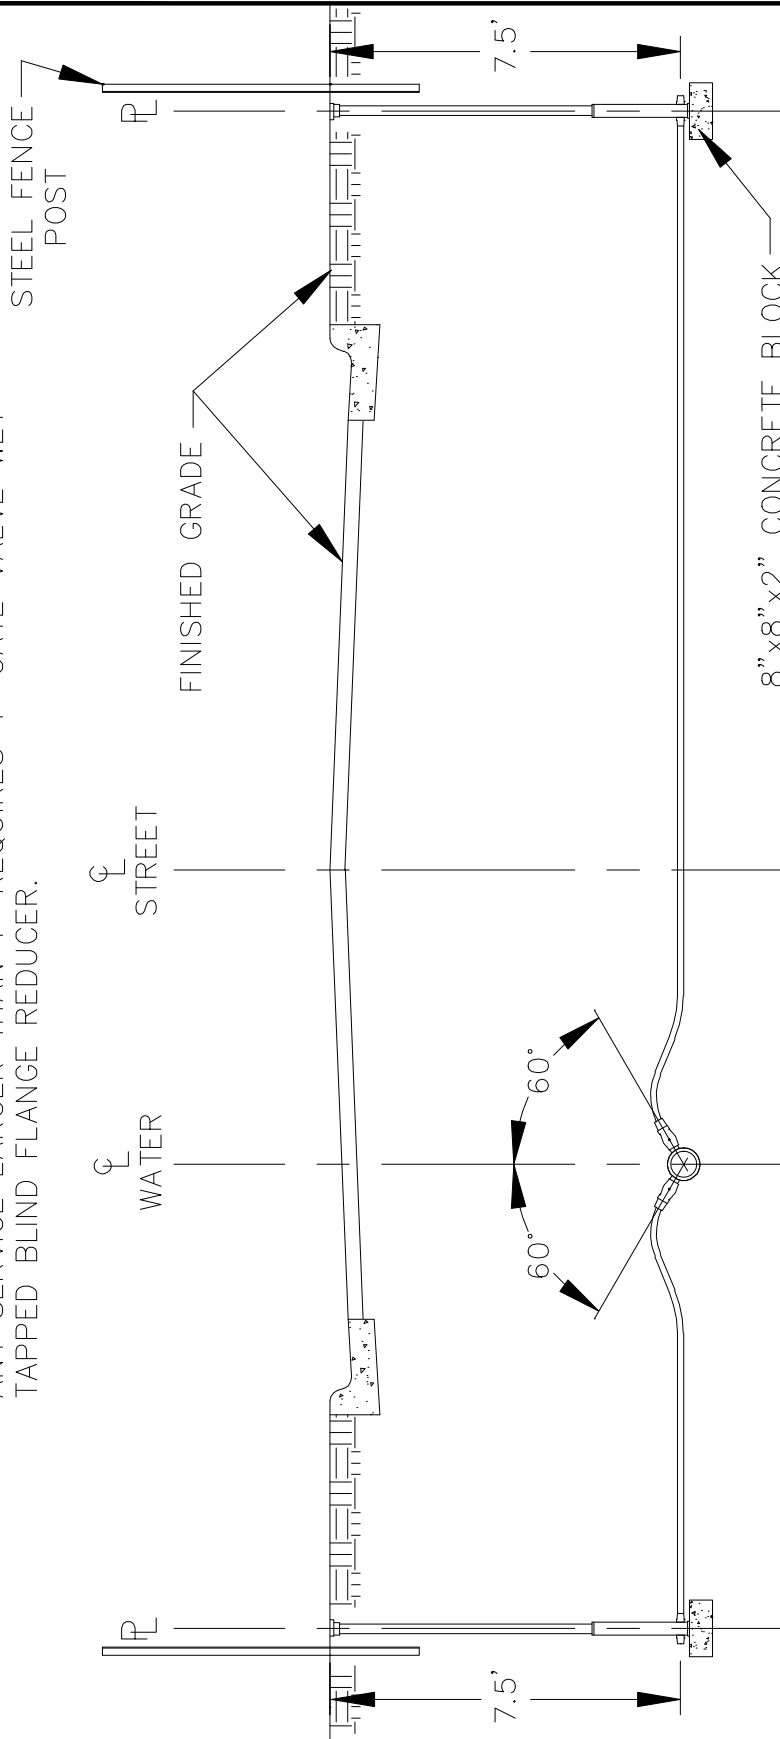

APPROVED MATERIALS:

CURB STOP - 1" FLARE X FLARE (FORD B22-444M) OR AY MCDONALD (6104-1)

CURB BOX - AY MCDONALD 5622 7 1/2

CORPORATION STOP - 1" AWWAX FLARE (FORD FB600-4) OR AY MCDONALD (4701B-1)

TAPS - 1" TAPS MAY BE MADE DIRECTLY INTO PIPE. 1.5" & LARGER TAPS REQUIRE AN APPROVED STAINLESS STEEL OR BRONZE SADDLE.

COPPER - TYPE K ONLY. NO JOINTS WILL BE ALLOWED ON 1" SERVICES LESS THAN 100' LONG.

APPROVED FEBRUARY 1, 2007

CITY ENGINEER REG 23110

TYPICAL WATER SERVICE
 (ON 6" TO 8" DUCTILE
 IRON MAIN)

City of **Golden Valley**
GV-WM-030