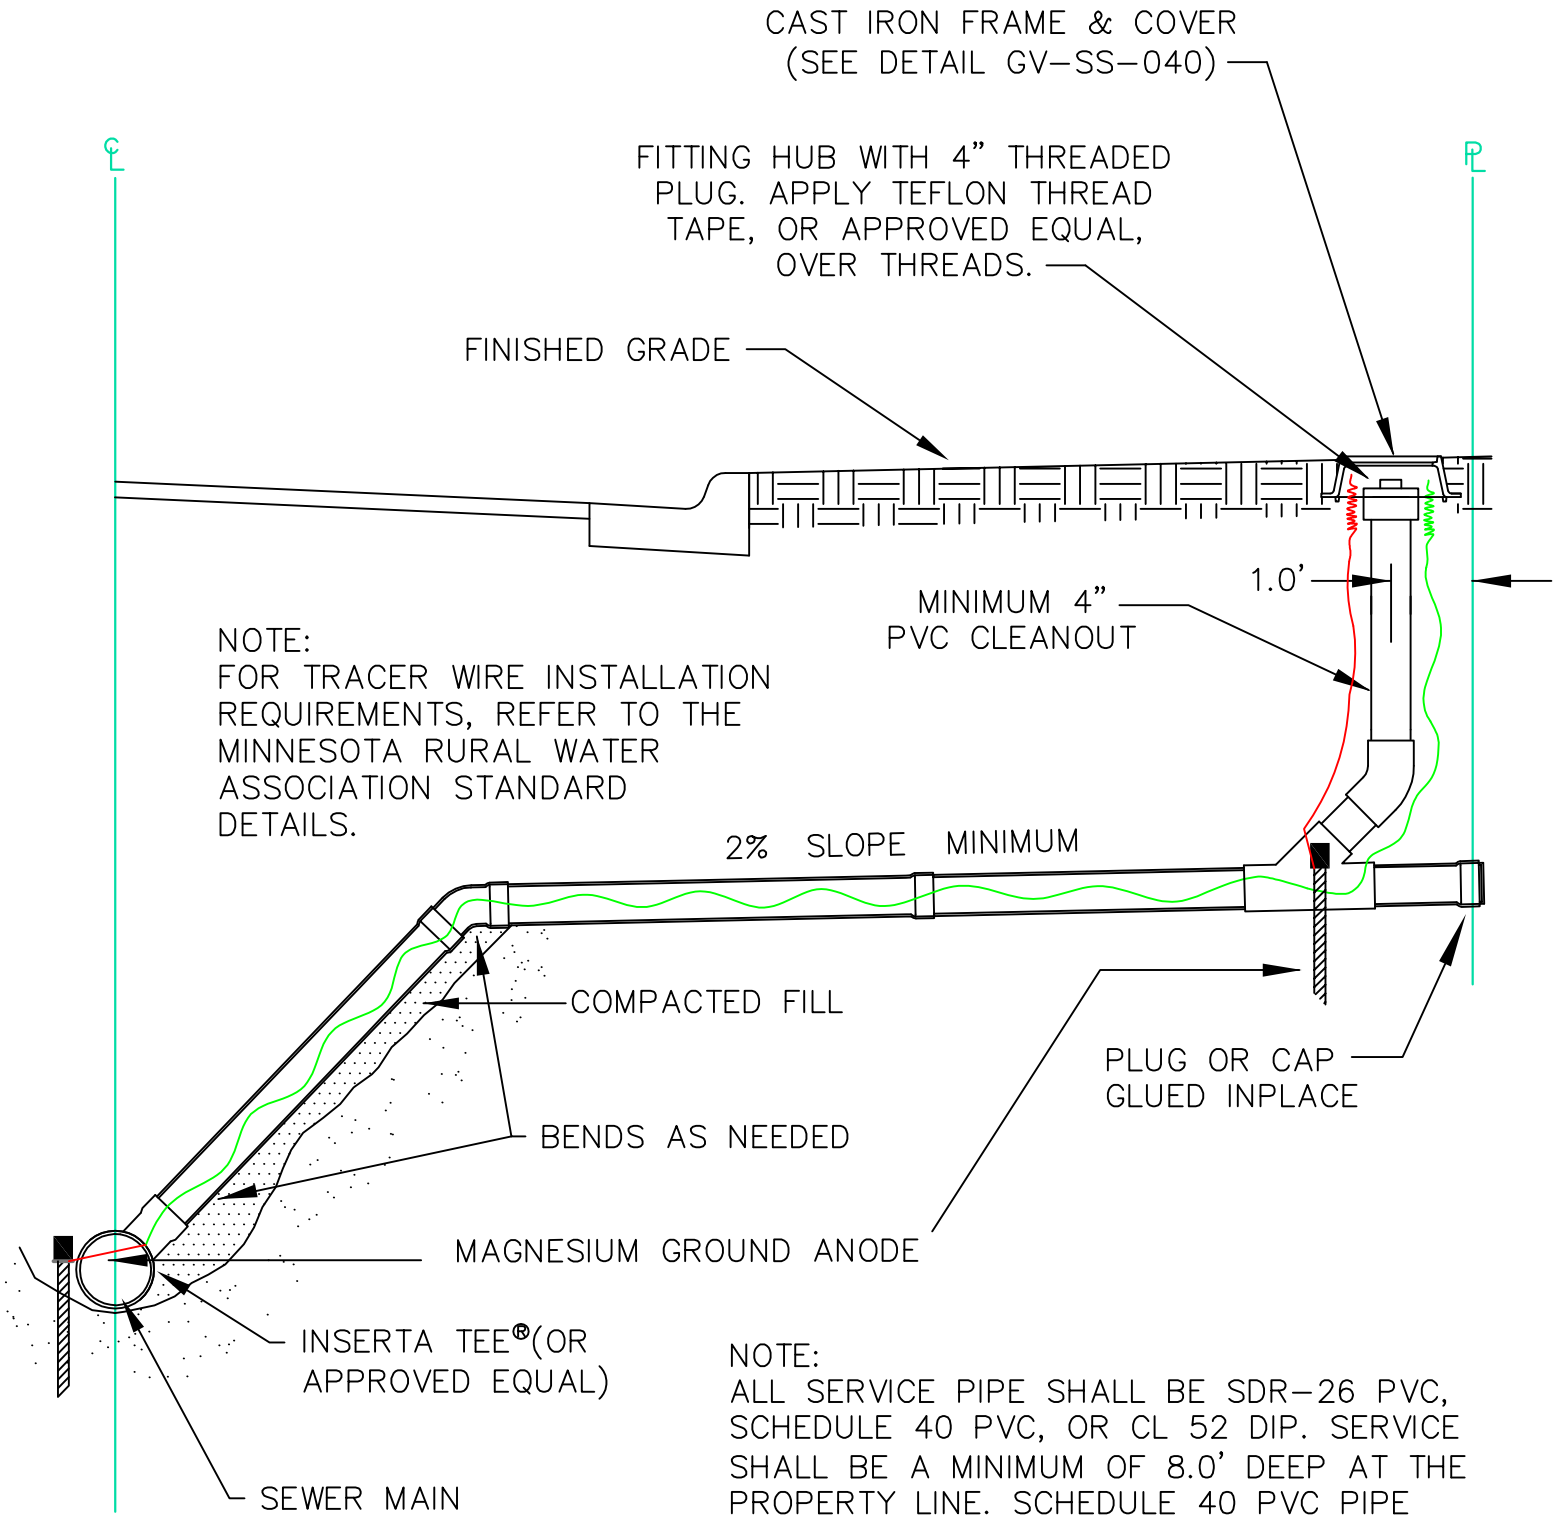

NOTE:
ALL SERVICE PIPE SHALL BE SDR-26 PVC, SCHEDULE 40 PVC, OR CL 52 DIP. SERVICE SHALL BE A MINIMUM OF 8.0' DEEP AT THE PROPERTY LINE. SCHEDULE 40 PVC PIPE SHALL HAVE SOLVENT JOINTS.

APPROVED JANUARY 1, 2018

CITY ENGINEER REG 23110

SANITARY SEWER SERVICE WITH RISER (DEEP SERVICE)

City of Golden Valley

GV-SS-050