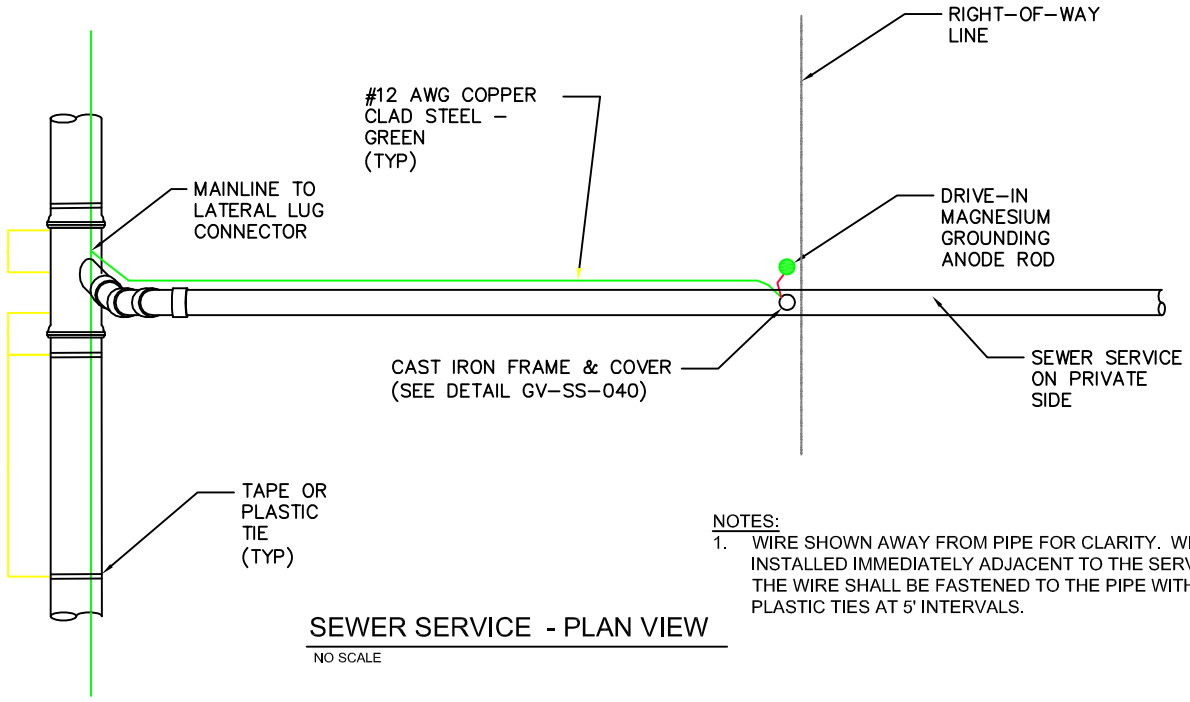

NOTES:

1. WIRE SHOWN AWAY FROM PIPE FOR CLARITY. WIRE SHALL BE INSTALLED IMMEDIATELY ADJACENT TO THE SERVICE PIPE. THE WIRE SHALL BE FASTENED TO THE PIPE WITH TAPE OR PLASTIC TIES AT 5' INTERVALS.

SEWER SERVICE - PLAN VIEW

NO SCALE

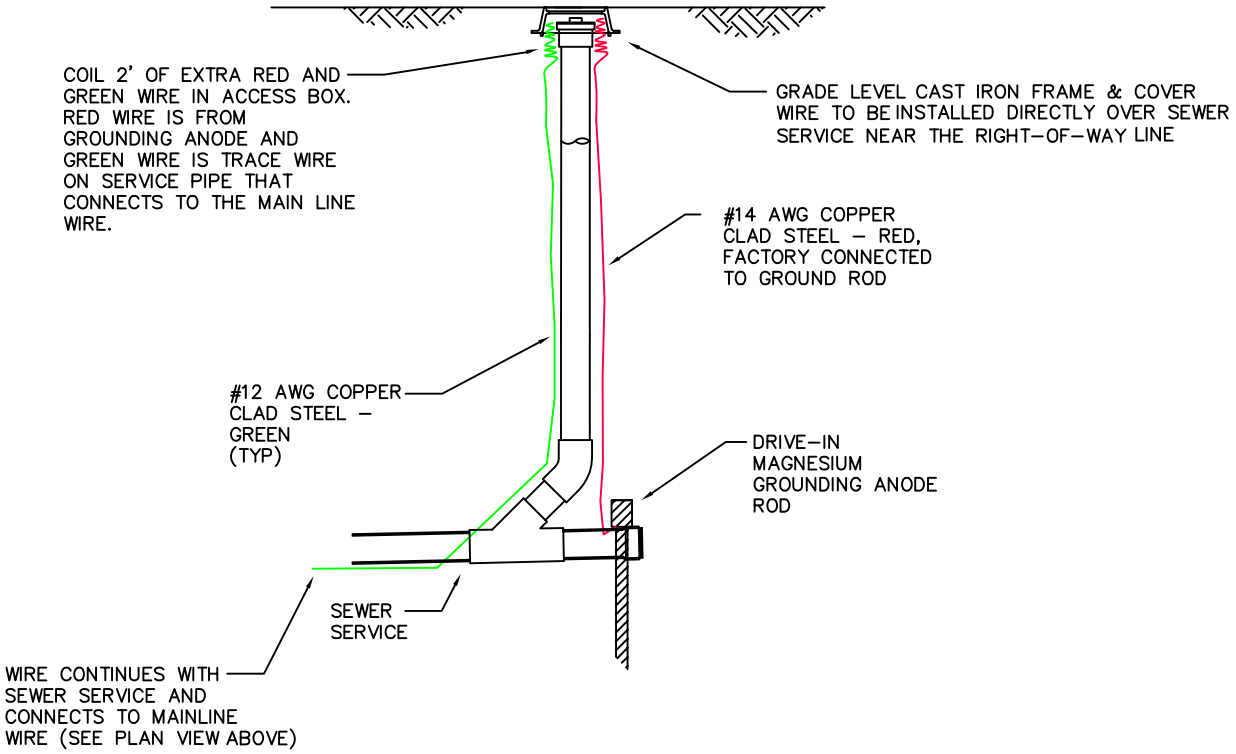

SEWER SERVICE - SECTION VIEW

NO SCALE

APPROVED DECEMBER 31, 2015

CITY ENGINEER REG 23110

TRACE WIRE PLAN (SEWER SERVICE)

MINNESOTA RURAL WATER ASSOCIATION STANDARD DETAIL

City of Golden Valley

GV-SS-100