

EZ SEE HYDRANT MARKER (72610 W-R 10501) W/RED REFLECTIVE TAPE 65" OVERALL LENGTH.

APPROVED MATERIALS:


FITTINGS - ALL FITTINGS SHALL BE EPOXY COATED DUCTILE IRON AND BOLTED WITH EPOXY COATED STAINLESS STEEL OR COR-BLUE BOLTS AND NUTS.

HYDRANTS - AVK DRY BARREL SERIES 2700 OR APPROVED EQUAL (THREADS - NATIONAL STANDARD ON 2 1/2" BUTTS AND MINNEAPOLIS ON 4 1/2" STEAMER NOZZLE). HYDRANTS SHALL BE PAINTED IN AVK YELLOW.

PIPE - CL 52 DIP (MINIMUM).

GATE VALVE BOX - SIZE G DUCTILE IRON, TYLER 6860, WITH 5" DROP LID HAVING THE WORD "WATER" CAST THEREON AND #6 ROUND BASE. THE BOXES SHALL EXTEND NOT LESS THAN 12" UPWARD FROM INITIAL INSTALLED POSITION AND INCLUDE A POWER SEAL MODEL 5000 VALVE BOX ALIGNER, EPOXY COATED 1/4" STEEL PER ASTM A53/A512.

GATE VALVE - AVK VALVE SERIES 65 WITH EXTERIOR EPOXY COATING.

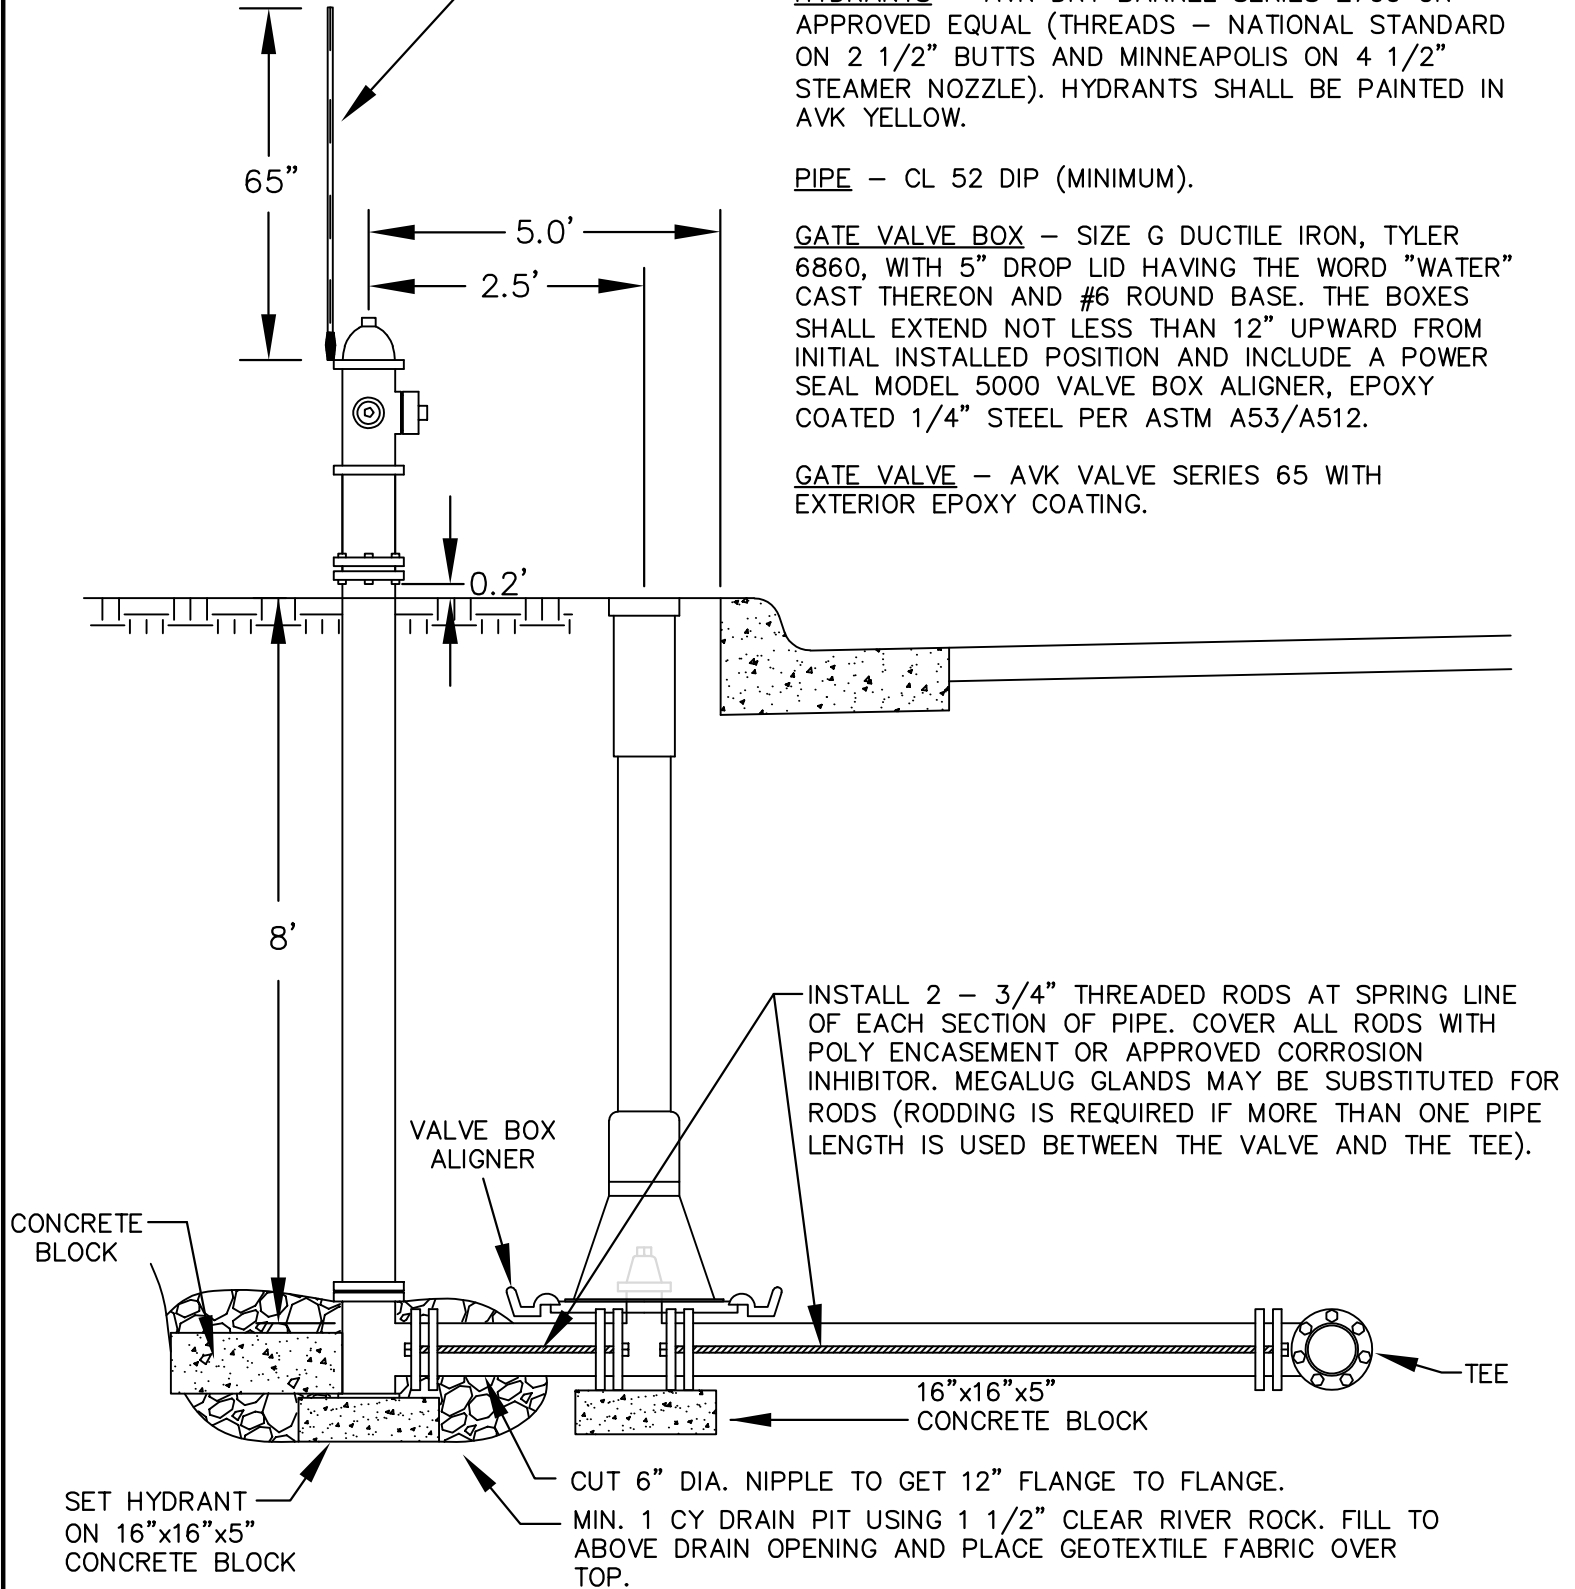

APPROVED JANUARY 1, 2018

CITY ENGINEER REG 23110

TYPICAL HYDRANT INSTALLATION

City of Golden Valley

GV-WM-010