


NOTE:

FORM GOOSENECK 6" ABOVE TAP TO ALLOW FOR SETTLEMENT
 MAINTAIN A MINIMUM OF 8' OF COVER OVER SERVICE.

ANY SERVICE LARGER THAN 1" TO BE 1.5"/2" C-900 SDR 7 OR (4"STUB) TO PROPERTY
 LINE WITH 4" GATE VALVE AND FLANGED REDUCER.

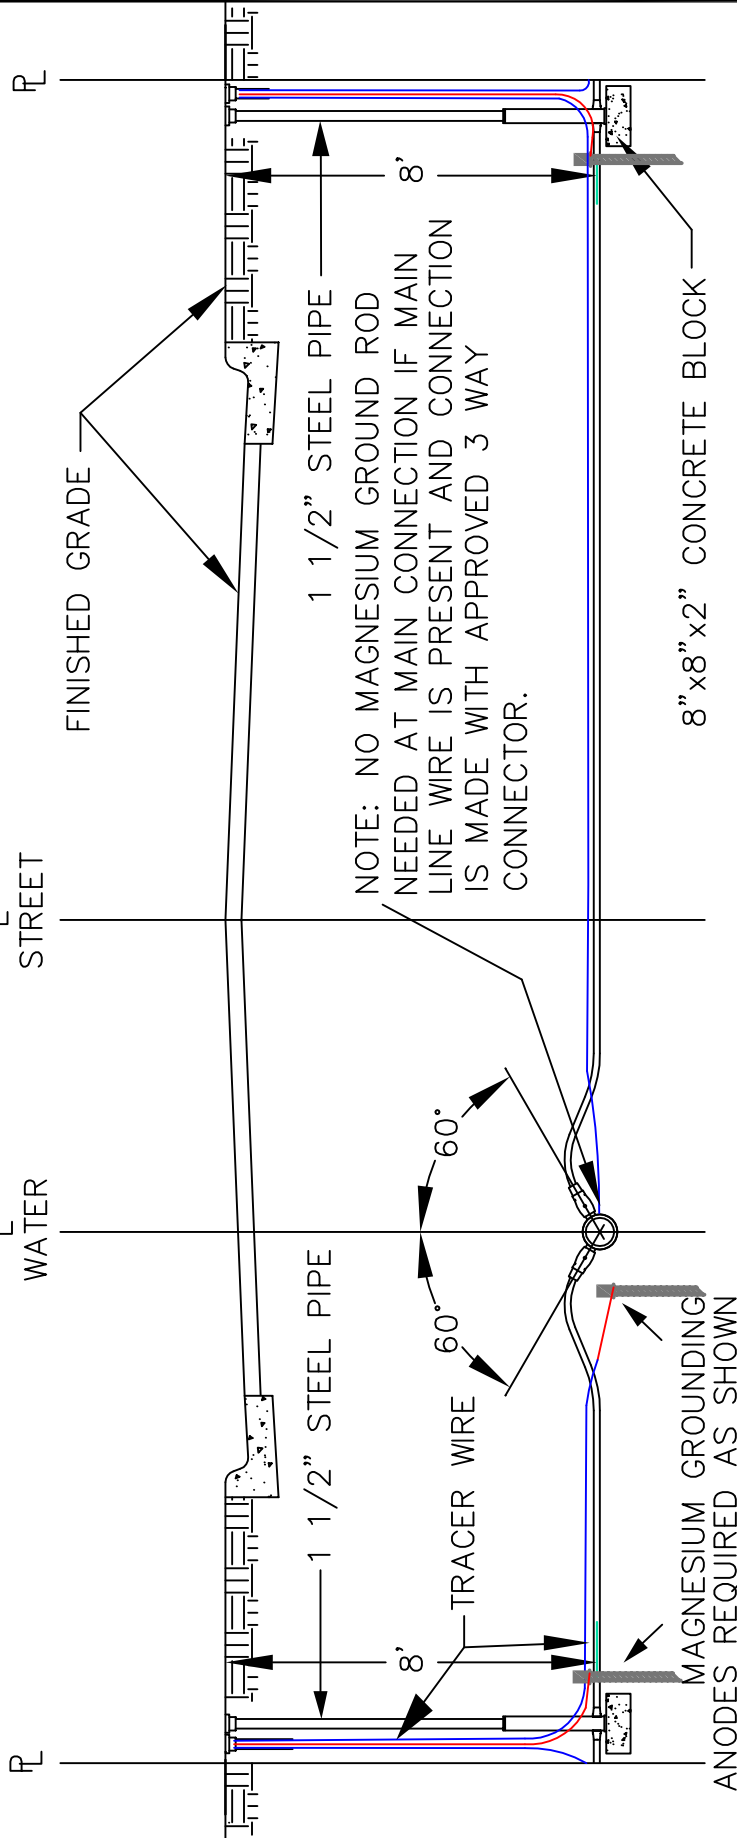

APPROVED MATERIALS FOR COPPER & (PLASTIC) PIPING:

CURB STOP – 1" CURB STOP AY MCDONALD 76104 OR (PLASTIC 76104--33)

CURB BOX – AY MCDONALD SERIES 5622A 8 CURB BOX COMPLETE W/5623LTW LID-- NO EXTENSION

CORPORATION STOP – 1" AY MCDONALD 74701B OR (PLASTIC 74701B--33)

TAPS – 1" SMITH-BLAIR SERIES 372 STAINLESS STEEL SERVICE SADDLE

WATER SERVICE – COPPER TYPE K OR C900 (PLASTIC W/ 1" SS INSERT AY MCDONALD 6136)
 W/TRACER WIRE AS SHOWN OR MINNESOTA RURAL WATER ASSOCIATION STANDARDS.

APPROVED JANUARY 1, 2018

CITY ENGINEER REG 23110

TYPICAL WATER SERVICE
 (ON 6" TO 8" MAIN)



GV-WM-020